

DATASHEET

CTS ATEX APPROVED TANK ALARM



CTS
CENTRE TANK
SERVICES LTD


OFFICIAL UAE
DISTRIBUTOR

Specifications

- › ATEX approved tank alarm for alerting of a high fluid level and fluid within the bund of a double walled tank which may indicate a leak or rain water ingress
- › Battery powered for use on portable installations or sites where mains power is inaccessible
- › Flashing red LED & 95db alarm will sound to alert the user
- › Siren will sound continuously for 120 seconds followed by a periodic beep for 60 minutes
- › Alarm automatically cancels when the zone is deactivated
- › Test battery, test alarm & alarm cancel functions
- › IP65 metal enclosure
- › ATEX approved for Zone 1 II2G Ex ia IIB T4 Gb
- › Version with 5m probe for use with diesel, kerosene and JET A1
- › Version without probe for use with other fluids such as petrol using a third party ATEX probe with solid stem



Dimensions

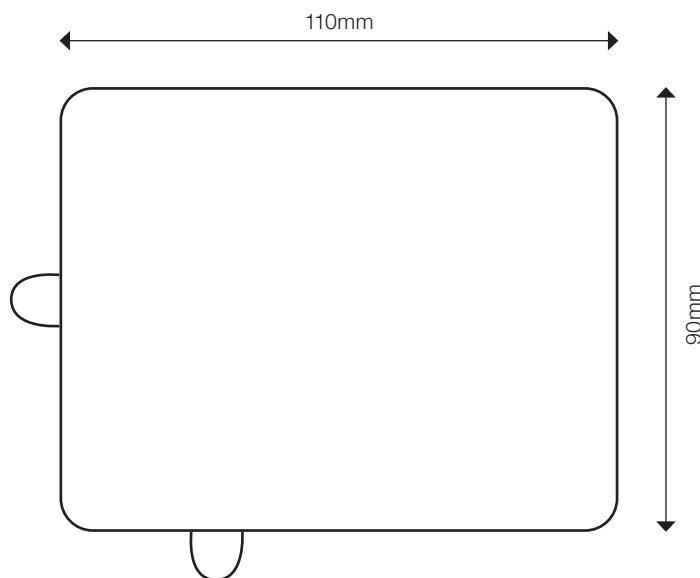

Code	Description	Battery	Probe	Zone	Fluids
SWS2006	ATEX Tank Alarm c/w Probe	AAA	✓*	Two - High and Bund	D K J H&G
SWS3023	ATEX Tank Alarm Only	AAA		Two - High and Bund	AF**

*5m max. probe length. **Depending upon compatibility of third party probe used **Please note:** all cables must be free of electrical noise.